



中国国家强制性产品认证证书

证书编号：2024010302659570

认证委托人名称及地址

法国溯高美电气公司

1, Rue De Westhouse 67230 Benfeld Cedex France

生产者名称及地址

法国溯高美电气公司

1, Rue De Westhouse 67230 Benfeld Cedex France

生产企业名称及地址

法国溯高美电气公司

1, Rue De Westhouse 67230 Benfeld Cedex France

产品名称和系列、型号、规格

负荷隔离开关

SIRCO PV 100A 500V /P, SIRCO PV 160A 500V /P, SIRCO PV 250A 500V /P,
SIRCO PV 315A 500V /P;详情见附页

产品标准和技术要求

GB/T 14048.3-2017

上述产品符合《强制性产品认证实施规则 低压电器 低压元器件》
(CNCA-C03-02:2024) 的要求，特发此证。

发证日期：2024年07月17日 有效期至：2029年07月16日

证书信息和有效性可扫描下方二维码或登录发证机构网站查验，
也可在认监委网站（www.cnca.gov.cn）查询。



签发：

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司






中国国家强制性产品认证证书

证书编号: 2024010302659570

证书附页: 第 1 页 共 1 页

SIRCO PV 100A 500V P, SIRCO PV 160A 500V P
SIRCO PV 250A 500V P, SIRCO PV 315A 500V P;
额定冲击耐受电压 (U_{imp}): 12kV;
额定绝缘电压 (U_i): 1500V;
约定发热电流 (I_{th}): 100A, 160A, 250A, 315A;
额定工作电压 (U_e): DC 1000V (适用 2 极外形和 4 极外形), DC 1500V (适用 4 极外形);
额定工作电流 (I_e): 100A, 160A, 250A, 315A;
额定短时耐受电流 (I_{cw}): 5kA / 1s;
额定短路接通能力 (I_{cm}): 10kA;
使用类别: DC-21B;
极数: 2P 外形, 4P 外形, 见直流接线图;

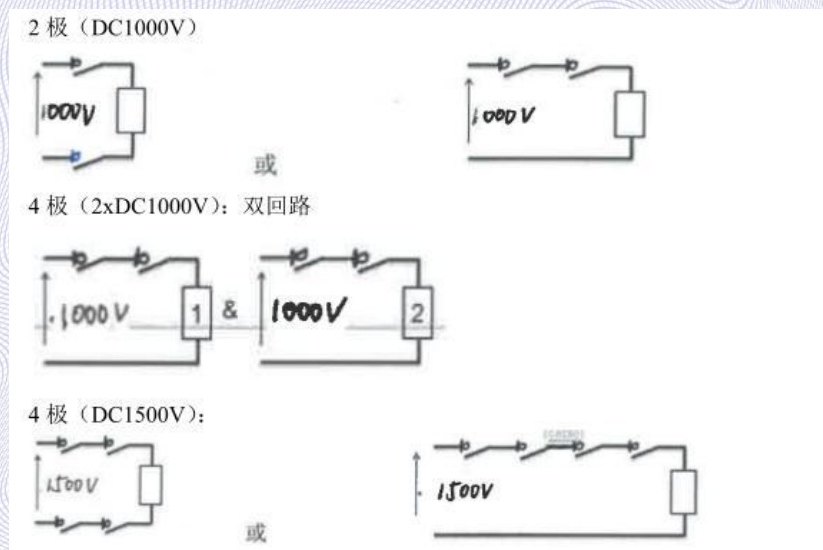

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2024010302659570

NAME AND ADDRESS OF THE APPLICANT
SOCOMEC S.A.S

1, Rue De Westhouse 67230 Benfeld Cedex France

NAME AND ADDRESS OF THE MANUFACTURER
SOCOMEC S.A.S

1, Rue De Westhouse 67230 Benfeld Cedex France

NAME AND LOCATION OF THE FACTORY
SOCOMEC S.A.S

1, Rue De Westhouse 67230 Benfeld Cedex France

PRODUCT NAME, MODEL AND SPECIFICATION

Load Switch-disconnector

SIRCO PV 100A 500V P, SIRCO PV 160A 500V P, SIRCO PV 250A 500V P, SIRCO PV 315A
500V P ;See attached page for details

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS
GB/T 14048.3-2017

This is to certify that the above mentioned product(s) complies with the requirements of
implementation rules for compulsory certification (REFNO. CNCA-C03-02:2024).

Valid from : Jul17,2024

Valid until: Jul16,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to
the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.






CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，不得单独使用
This translated document does not have legal validity and cannot be used in isolation

CERTIFICATE NO. : 2024010302659570

Appendix: Page 1 of 1

SIRCO PV 100A 500V /P, SIRCO PV 160A 500V /P
 SIRCO PV 250A 500V /P, SIRCO PV 315A 500V /P;
 Rated in pulse withstand voltage (U_{imp}): 12kV ;
 Rated insulation voltage (U_i): 1500V ;
 Agreed heating current (I_{th}): 100A , 160A , 250A , 315A ;
 Rated operating voltage (U_e): DC 1000V (suitable for 2-pole and 4-pole configurations), DC 1500V (suitable for 4-pole configurations);
 Rated working current (I_e): 100A , 160A , 250A , 315A ;
 Rated short-time withstand current (I_{cw}): 5kA /1s;
 Rated short-circuit making capacity (I_{cm}): 10kA ;
 Usage category: DC-21A ;
 Polarity: 2P shape, 4P shape, see DC wiring diagram ;

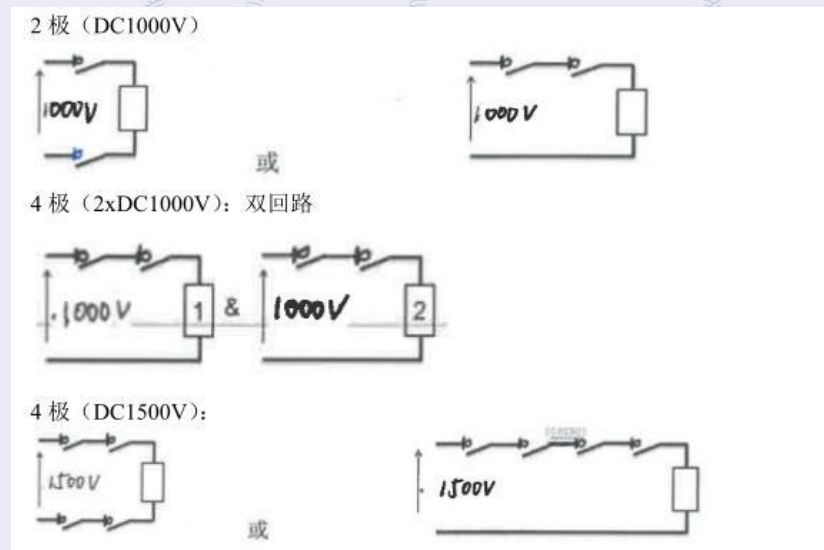

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.